


# Voltage Rise Calculation

Project Name: \_\_\_\_\_

Job No.: \_\_\_\_\_

Inverter: \_\_\_\_\_

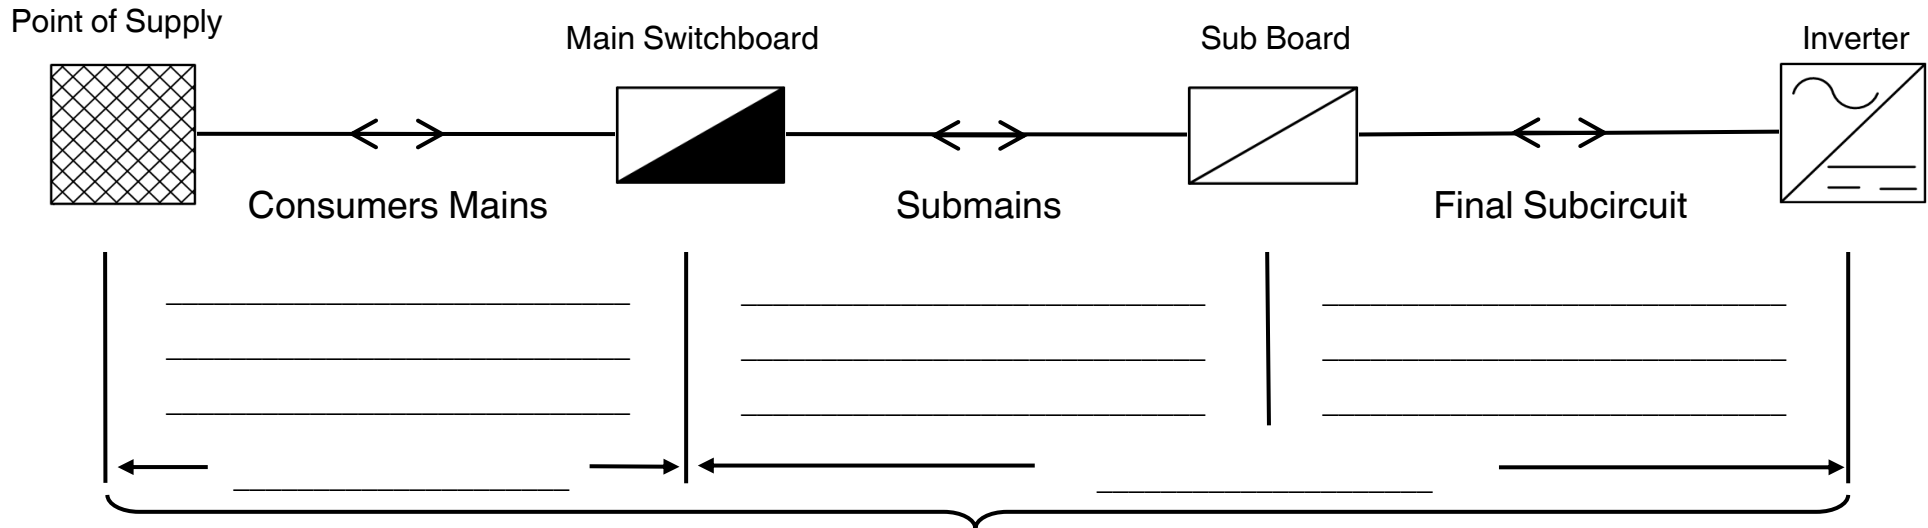

**Total Voltage Rise:**

**Maximum Allowed:**

1 AS/NZS 4777.1:2016 requires that the overall voltage rise from the point of supply to the inverter a.c. terminals (grid-interactive port) shall **not exceed 2%** of the nominal voltage at the point of supply.